


RECEIVED
MAY 3 2011
BY [Signature]


#19


LADWP
Water System
Shortage Year Rates
May 2, 2011



Los Angeles
Department of
Water & Power


Sources of LA's Water Supply Variability based on Availability

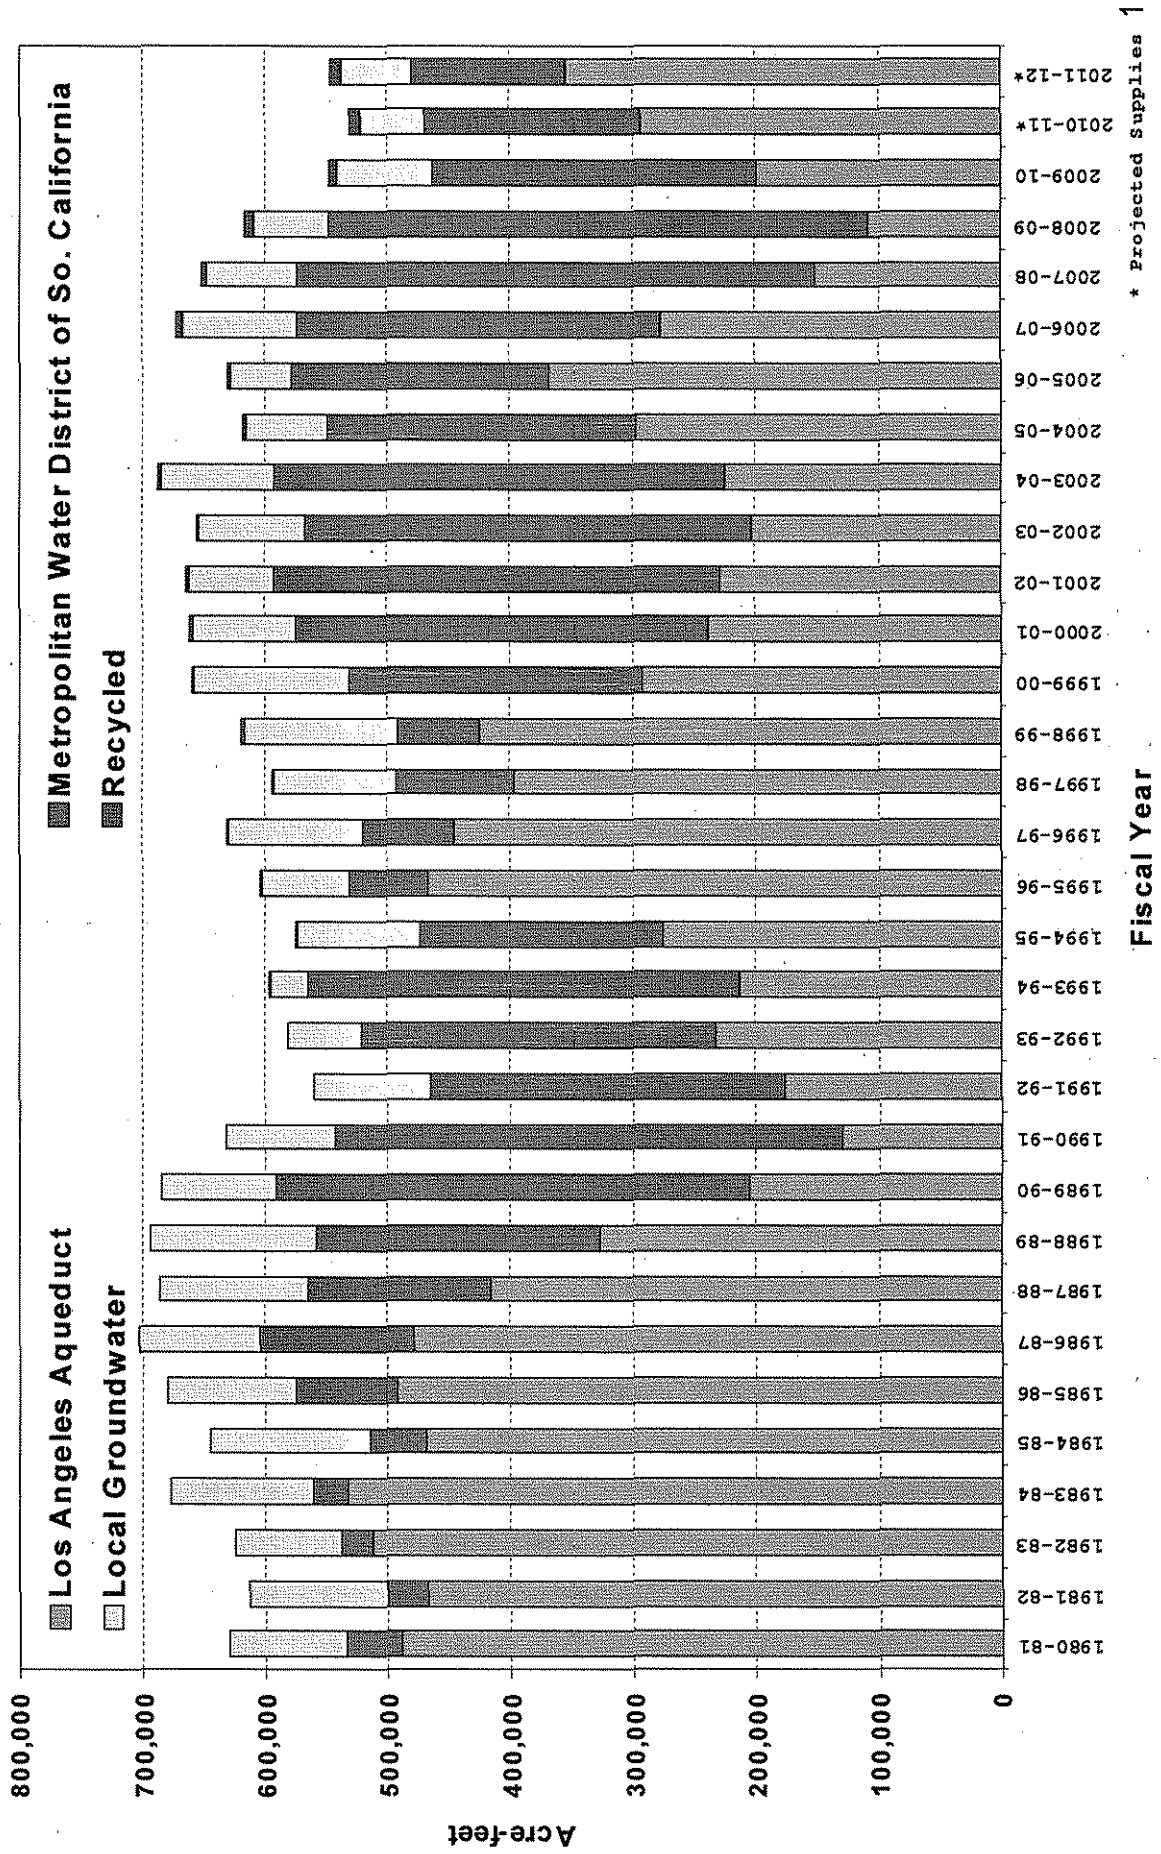




Los Angeles
Department of
Water & Power

State Supply

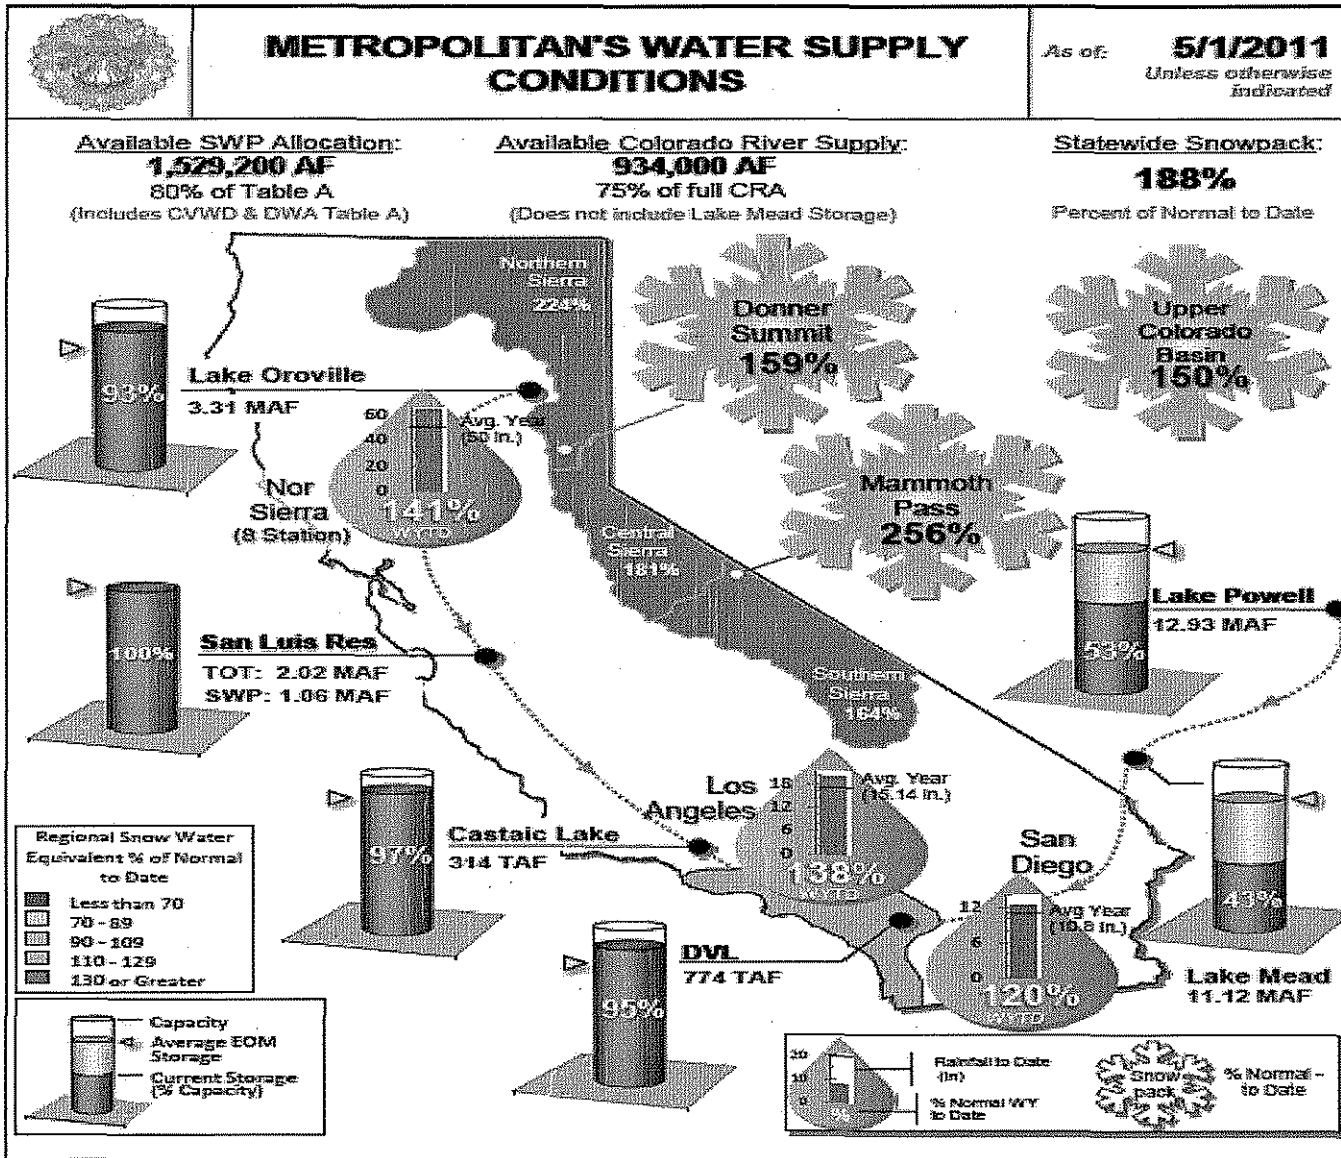





Los Angeles
Department of
Water & Power

High Run-off Projection Eastern Sierra

EASTERN SIERRA CURRENT PRECIPITATION CONDITIONS As of April 12, 2011


Mammoth Pass Snowpack

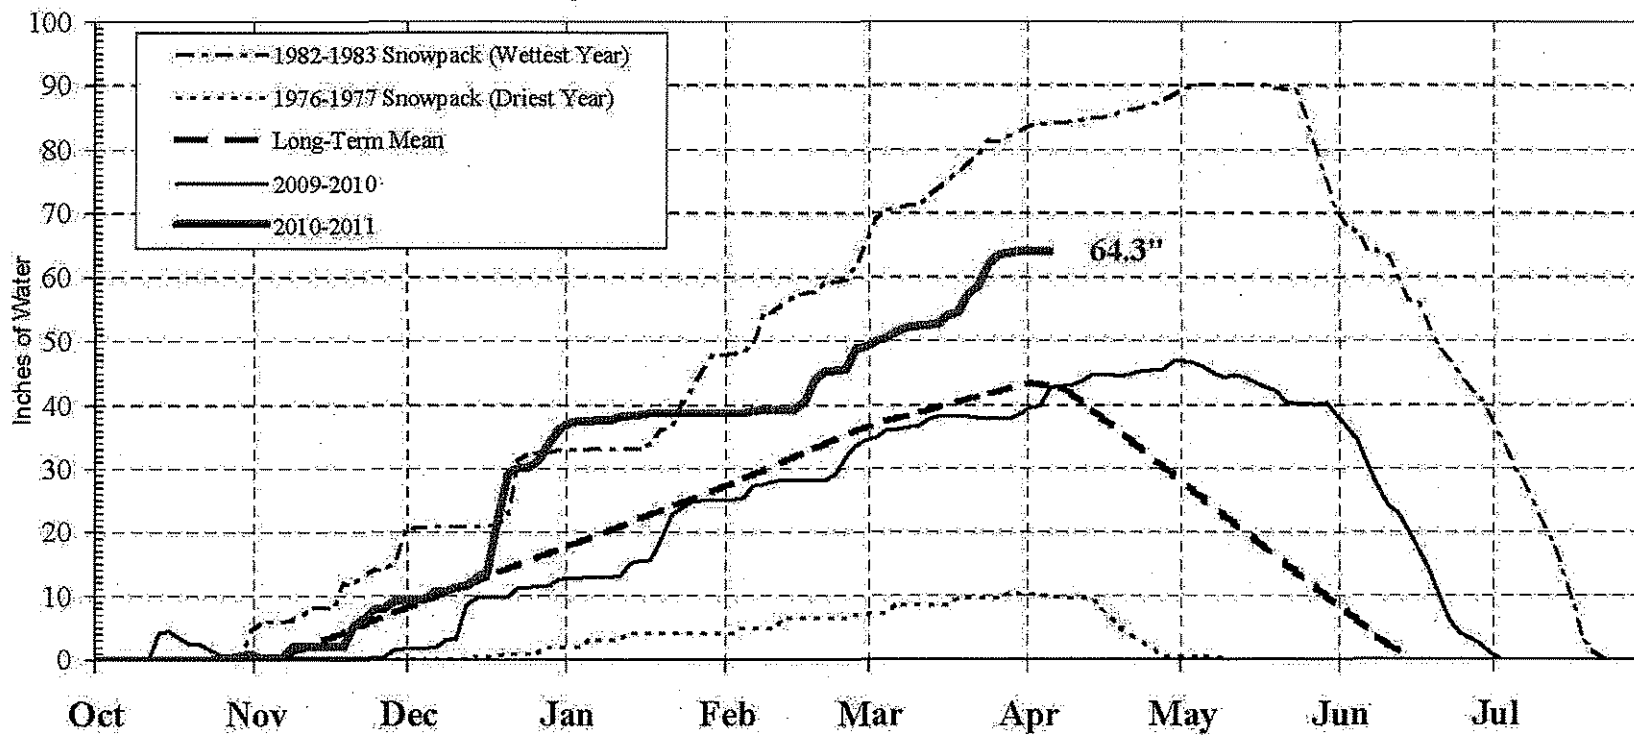




Los Angeles
Department of
Water & Power

Water Conservation Success in Los Angeles

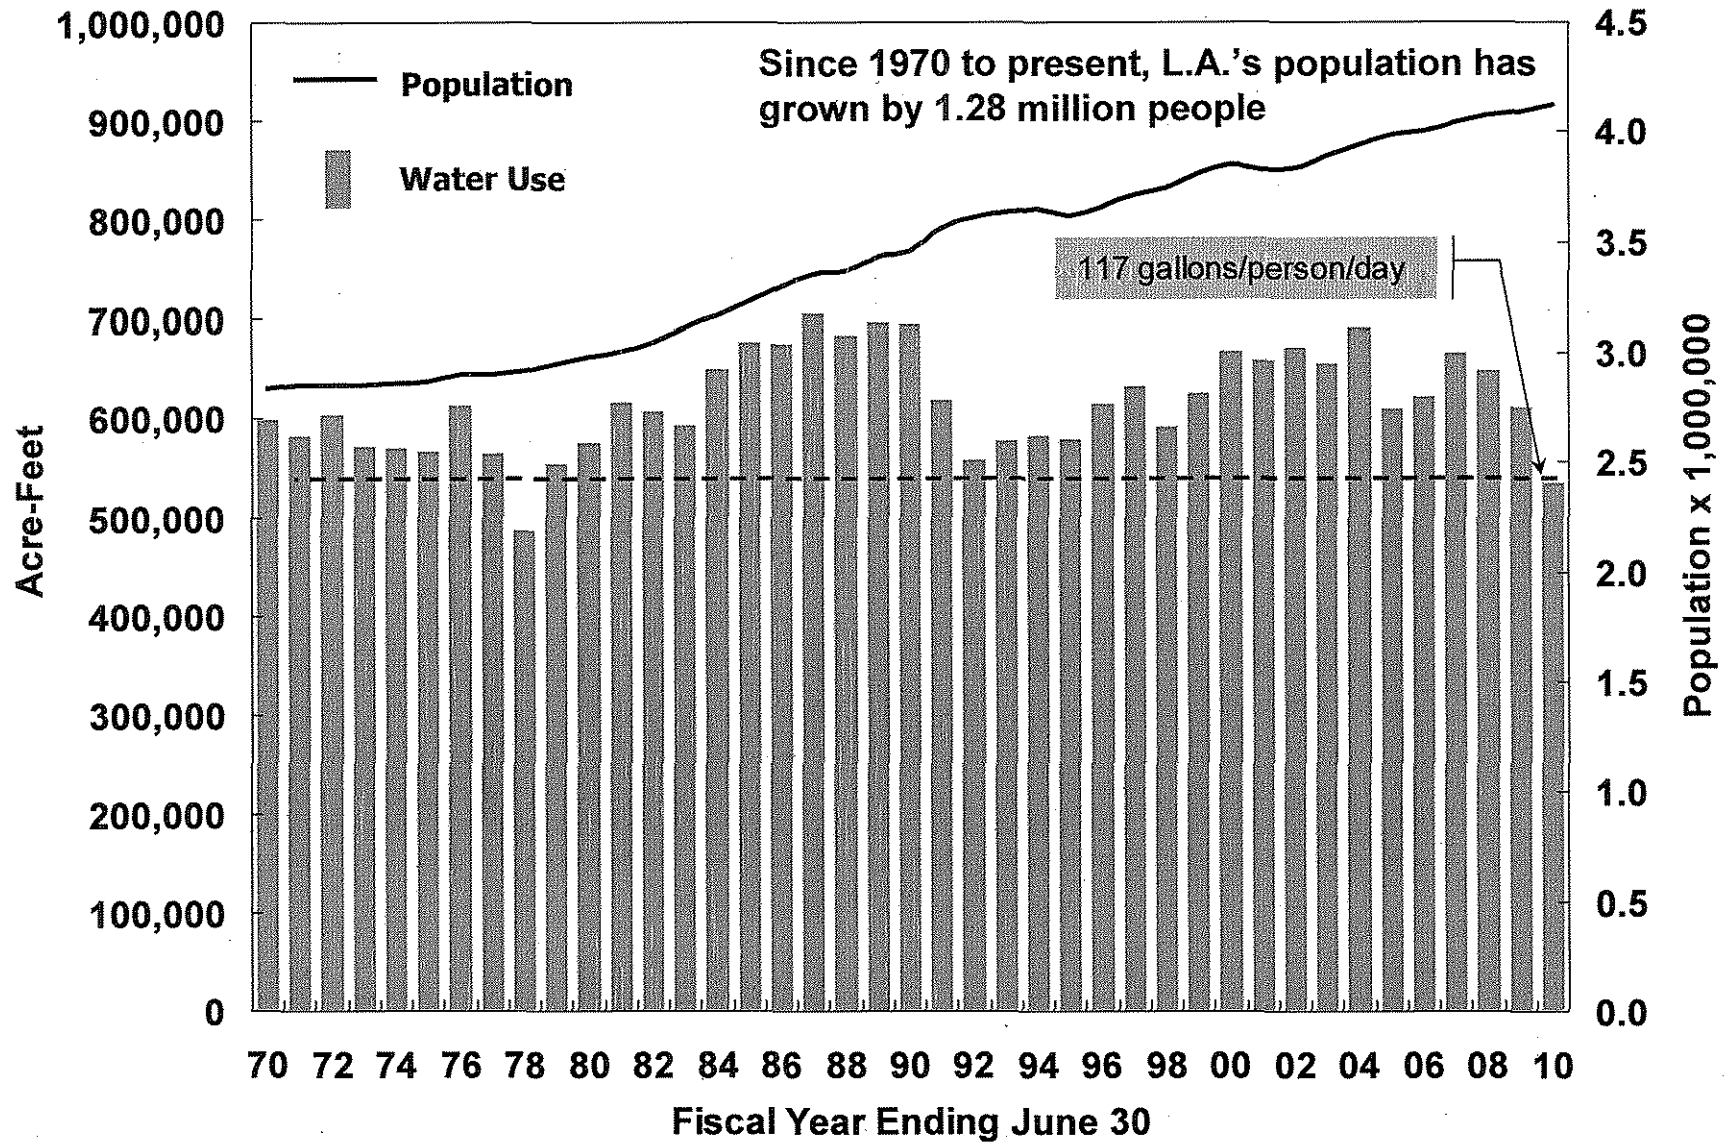




Los Angeles
Department of
Water & Power

Comparable Use with Other Cities

GPCD (Gallons Per Capita Per Day) for the Nine US Cities with Populations Greater Than 1,000,000

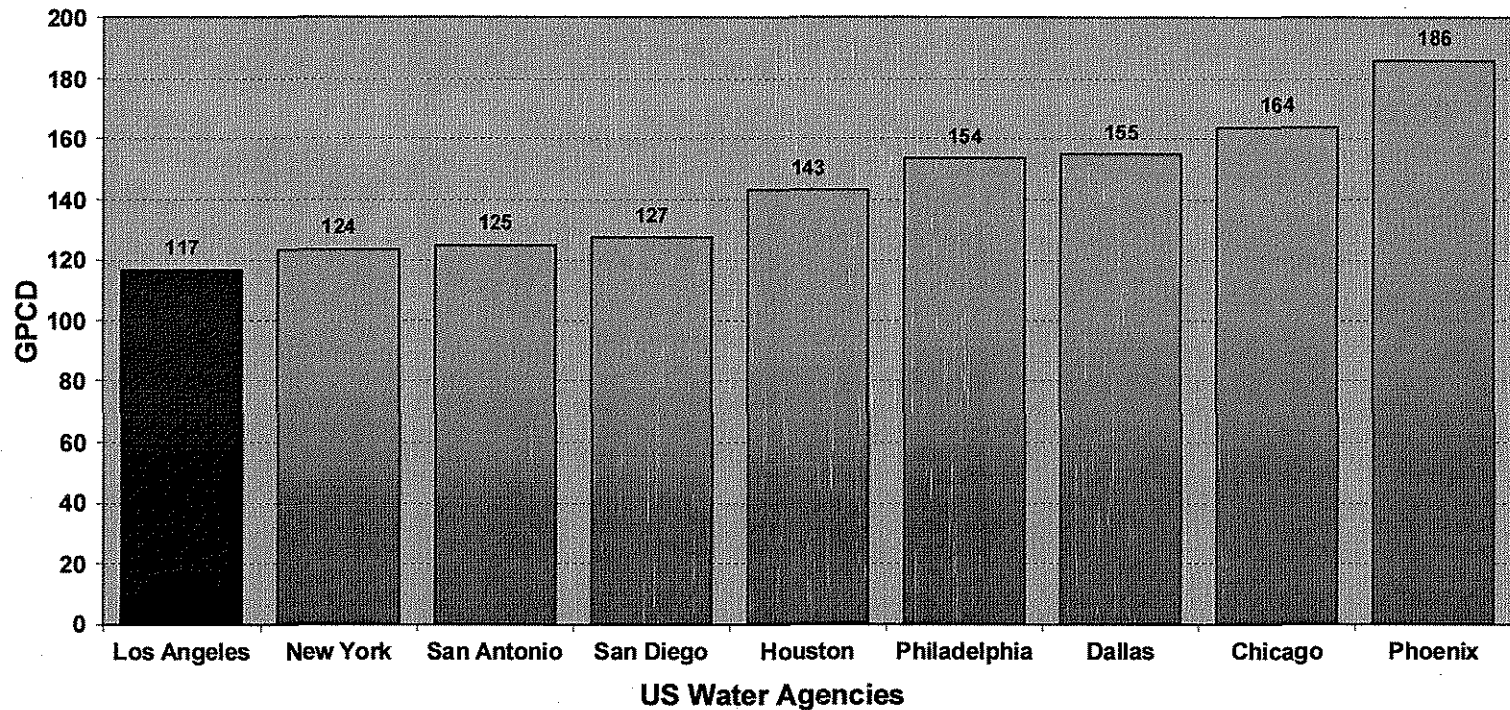

Notes:

- Los Angeles data based on FY 2009 - 2010, taking into account Recycled water. Therefore, calculated $GPCD = (Total\ LA\ Water\ Supply - Recycled\ Water) / Population$
- All other agencies are based on City website data or correspondence with agency personnel
- All calculations use total water use and population of service area for FY 09/10 or CY 2010